

SHU LIGHTNING COMPLEX

CA-SHU-004727

as of 07/07/08 - 0600 Hrs

53,600 Acres 65% Contained


Expected Containment 07/14/08

Started June 21, 2008 0500 Hrs

Shasta & Trinity Counties

Fire Threats and Damages
 2 Residences Destroyed
 3 Residences Damaged
 130 Residences Threatened

12 hours: Heavy fuel loads, low RH's, hot weather, remote areas, and steep topography will contribute to some fire movement. Fires continue to burn within interior islands of fuel. Significant amounts of indirect line have been constructed on all three major fires. If firing operations take place, fire size is expected to increase. Based on a lack of resources and no predicted burn window, we have adapted to a modified suppression action that will not necessitate the burn operation on the Motion fire. This action would lead to minimal increase in fire size, and yield a containment strategy that will result in 100% containment of the Motion fire with indirect line in a shorter time frame. This should free up resources for other state fires faster than other control options.

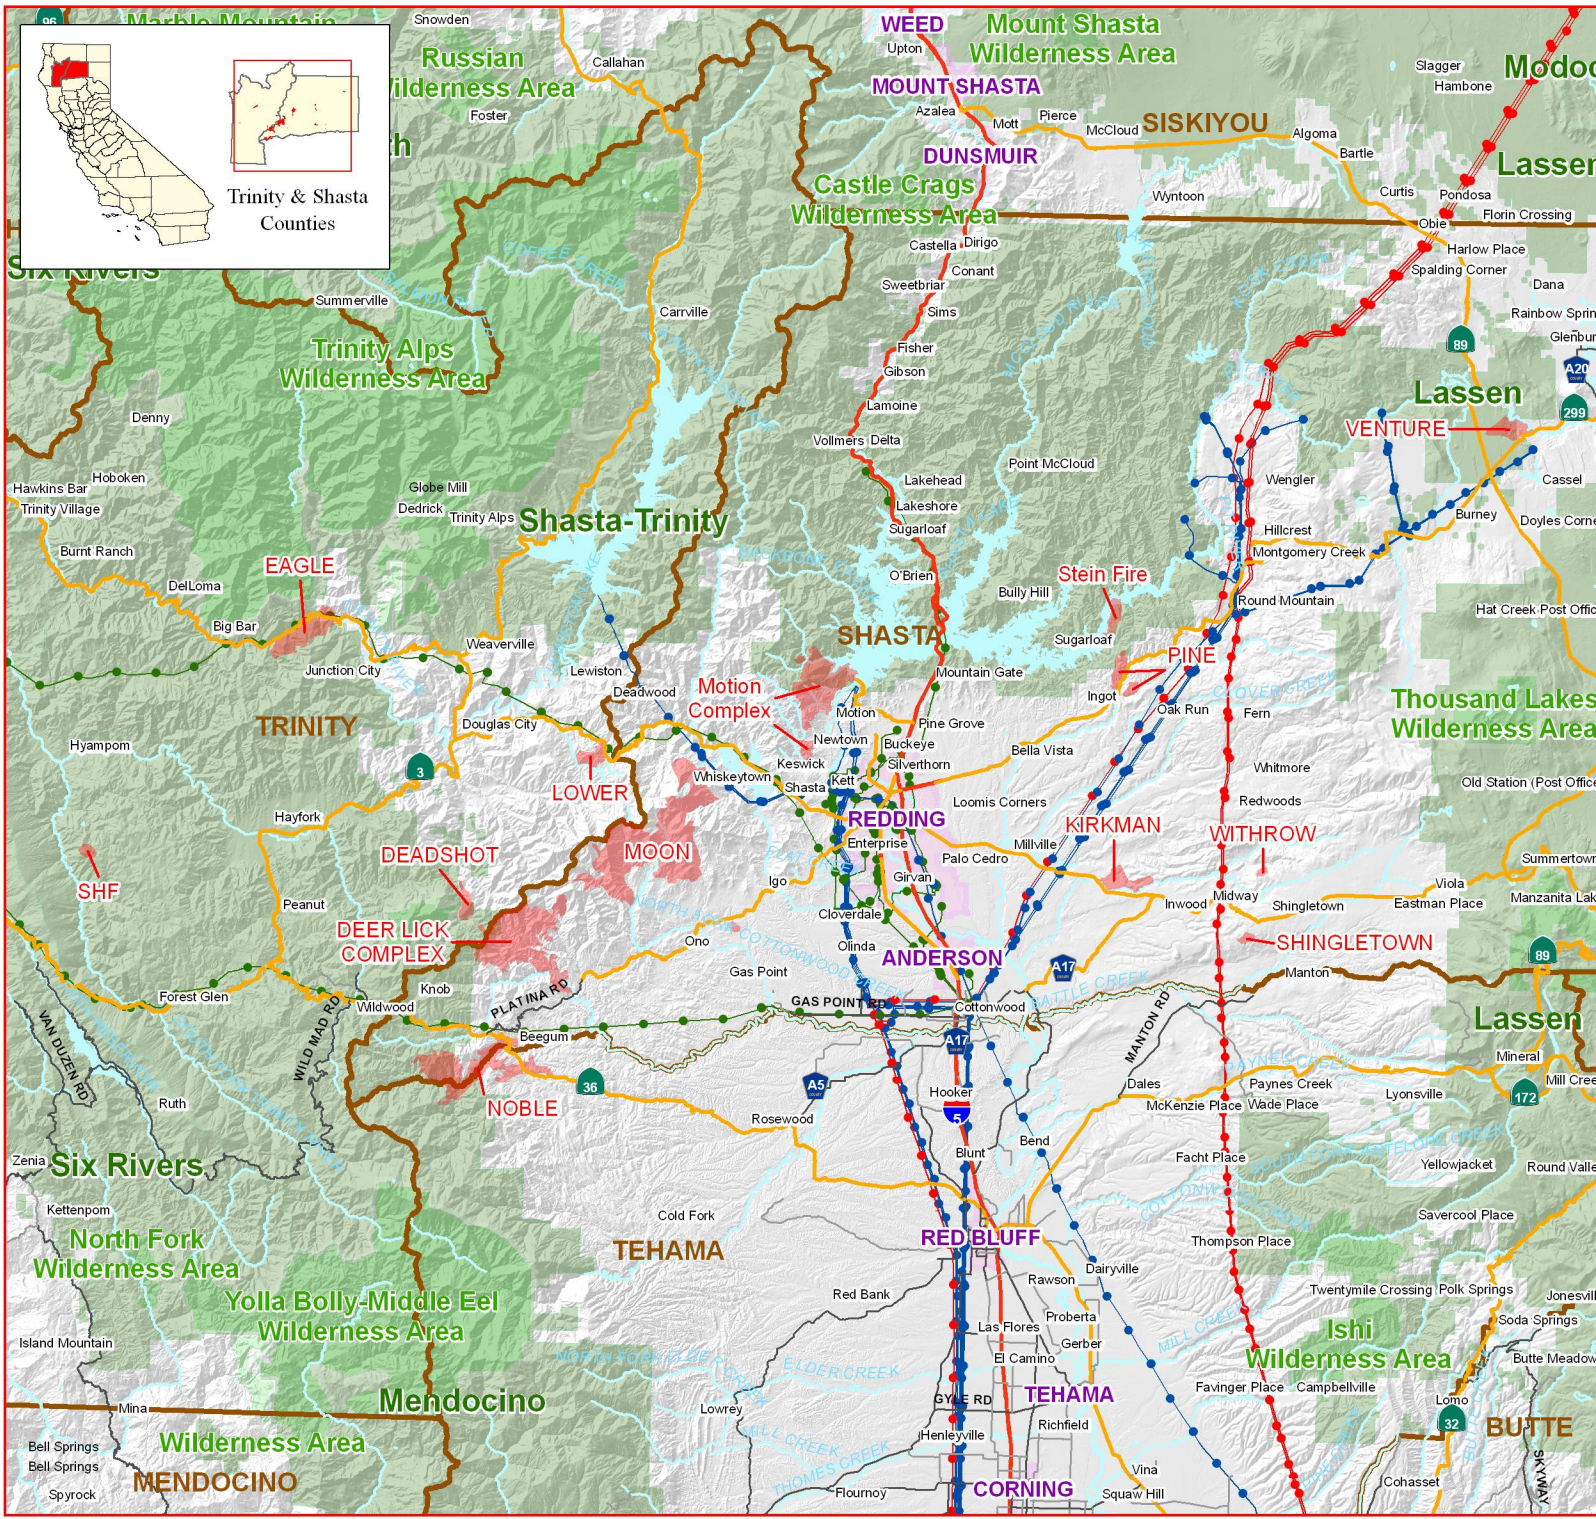


■ SHU Complex as of 070708 0730 Hrs

Transportation

- Freeways
- Highways
- Primary
- Secondary

Transmission Line

- 500KV
- 230KV
- 115KV
- Forest



Created by OES-GIS, Melinda Rogers
 July 7, 2008
 Sources: FAMIWEB 2008;
 active_incident/fires/2008/SHU_CA-SHU-004727/SHU_070708_A.mxd

